

# GMC 500 - 1500 UPC FOR UPC/IAPMO INSTALLATIONS GMC 750, 1000, 1250 FL FOR FLORIDA INSTALLATIONS INSTALLATION PROCEDURE

## NOTES:

- REFER TO INSTALLATION PROCEDURE AND INSTALLATION CHECKLIST.
- PROCEPTOR SEPARATORS MUST BE INSTALLED IN ACCORDANCE WITH ALL RELEVANT FEDERAL, PROVINCIAL/STATE, AND LOCAL CODES INCLUDING LOCAL PLUMBING CODE.  
US PATENT # 5,746,912; CDN PATENT # 2,195,822
- 

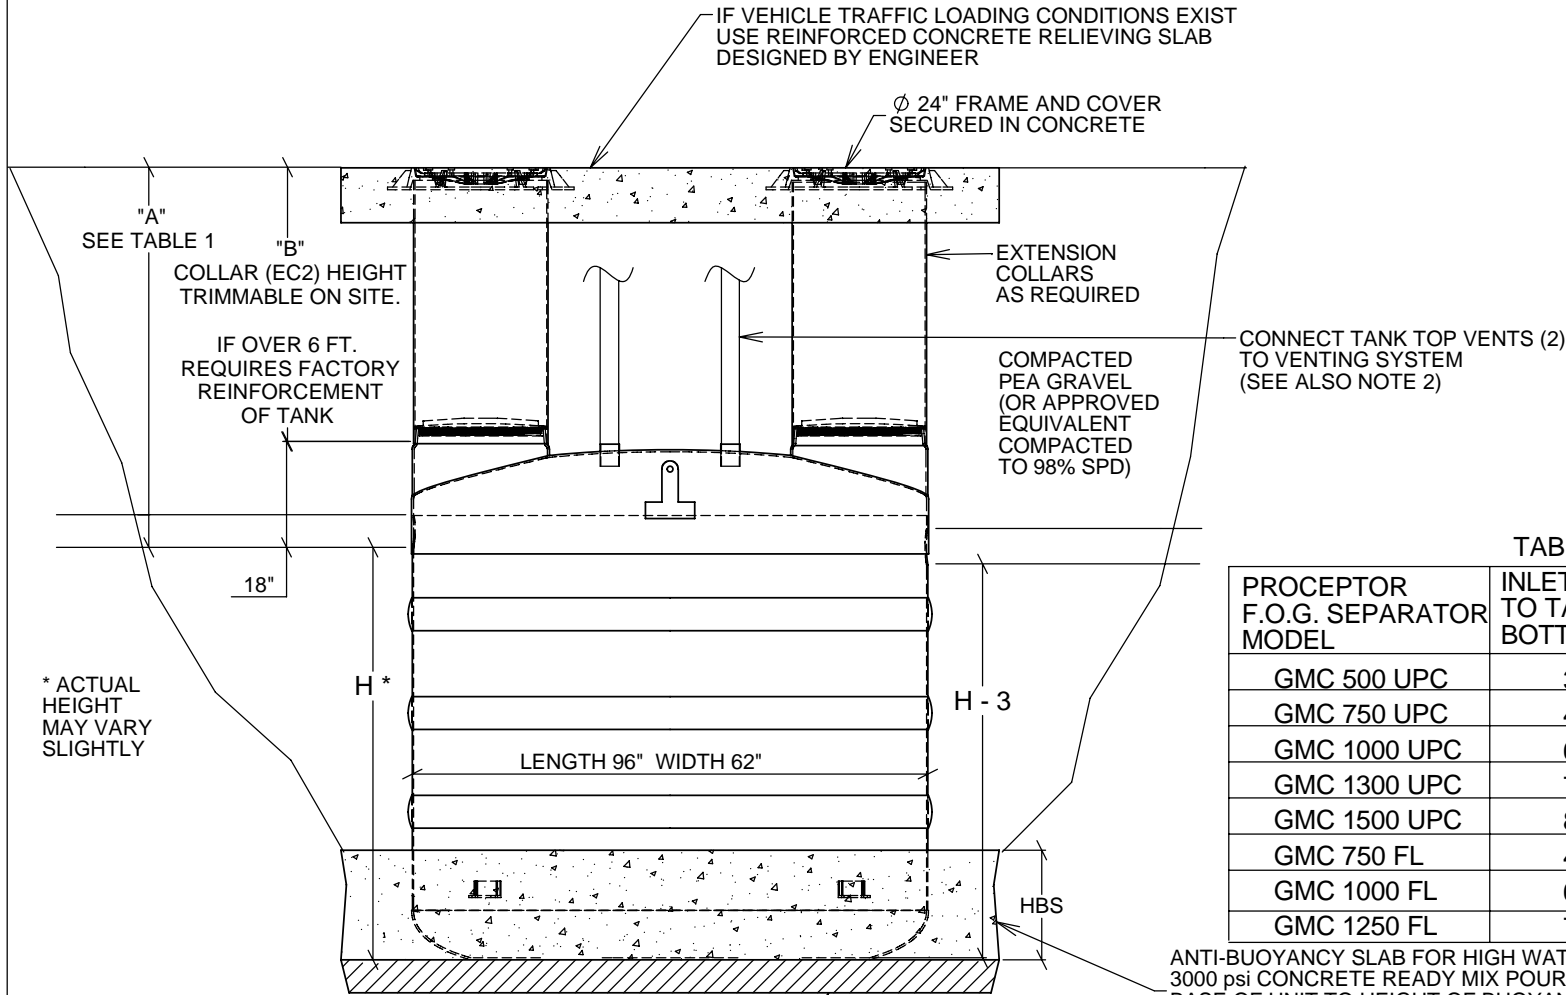


TABLE 2

PROCEPTOR F.O.G. SEPARATOR MODEL	INLET INVERT TO TANK BOTTOM (H*)	HEIGHT OF BUOYANCY SLAB (HBS)	DRY WEIGHT OF TANK
GMC 500 UPC	33"	18"	565 lbs
GMC 750 UPC	46"	19"	645 lbs
GMC 1000 UPC	60"	26"	720 lbs
GMC 1300 UPC	75"	35"	815 lbs
GMC 1500 UPC	86"	41"	875 lbs
GMC 750 FL	46"	19"	645 lbs
GMC 1000 FL	60"	26"	720 lbs
GMC 1250 FL	75"	35"	815 lbs

ANTI-BUOYANCY SLAB FOR HIGH WATER TABLE CONDITIONS ONLY  
3000 psi CONCRETE READY MIX POUR 12" HORIZONTALLY ALL AROUND  
BASE OF UNIT TO HEIGHT OF BUOYANCY SLAB (SEE TABLE 2)

TABLE 1

BURIAL DEPTH	A	B
Max.	7' 6"	6 ft.
Min. with Traffic	36"	18"
Min. no Traffic	28"	** 10"

\*\* MAY VARY DEPENDING ON VENT PIPING AND FLOOR SLAB

TITLE: PROCEPTOR F.O.G. SEPARATOR  
INSTALLATION FOR GMC  
500, 750, 1000, 1300, 1500 UPC  
750, 1000, 1250 FL

PROJECT: WO:

✓ OPTIONS:

REV	DATE	DRAWN
1		
2		
3	JUNE 1, 2005	L. SIMKINS
4	SEPT. 20, 2005	L. SIMKINS
5	MARCH 16, 2006	L. SIMKINS
6	FEBRUARY 5, 2007	L. SIMKINS
7	SEPTEMBER 13, 2007	L. SIMKINS
8	APRIL 16, 2008	L. SIMKINS
9		
10		

DRAWN BY: F CHANDLER

DRAWN DATE 6/18/04

Proceptor<sup>TM</sup>  
by greenturtle<sup>TM</sup>

US 877 428 8187 CAN 877 966 9444  
www.greenturtletech.com

SIZE	DWG. NO.	REV.
A	INSTALL GMC 500-1500 UPC FL	8

SCALE: 1:45 DO NOT SCALE DRAWING SHEET 1 OF 1